



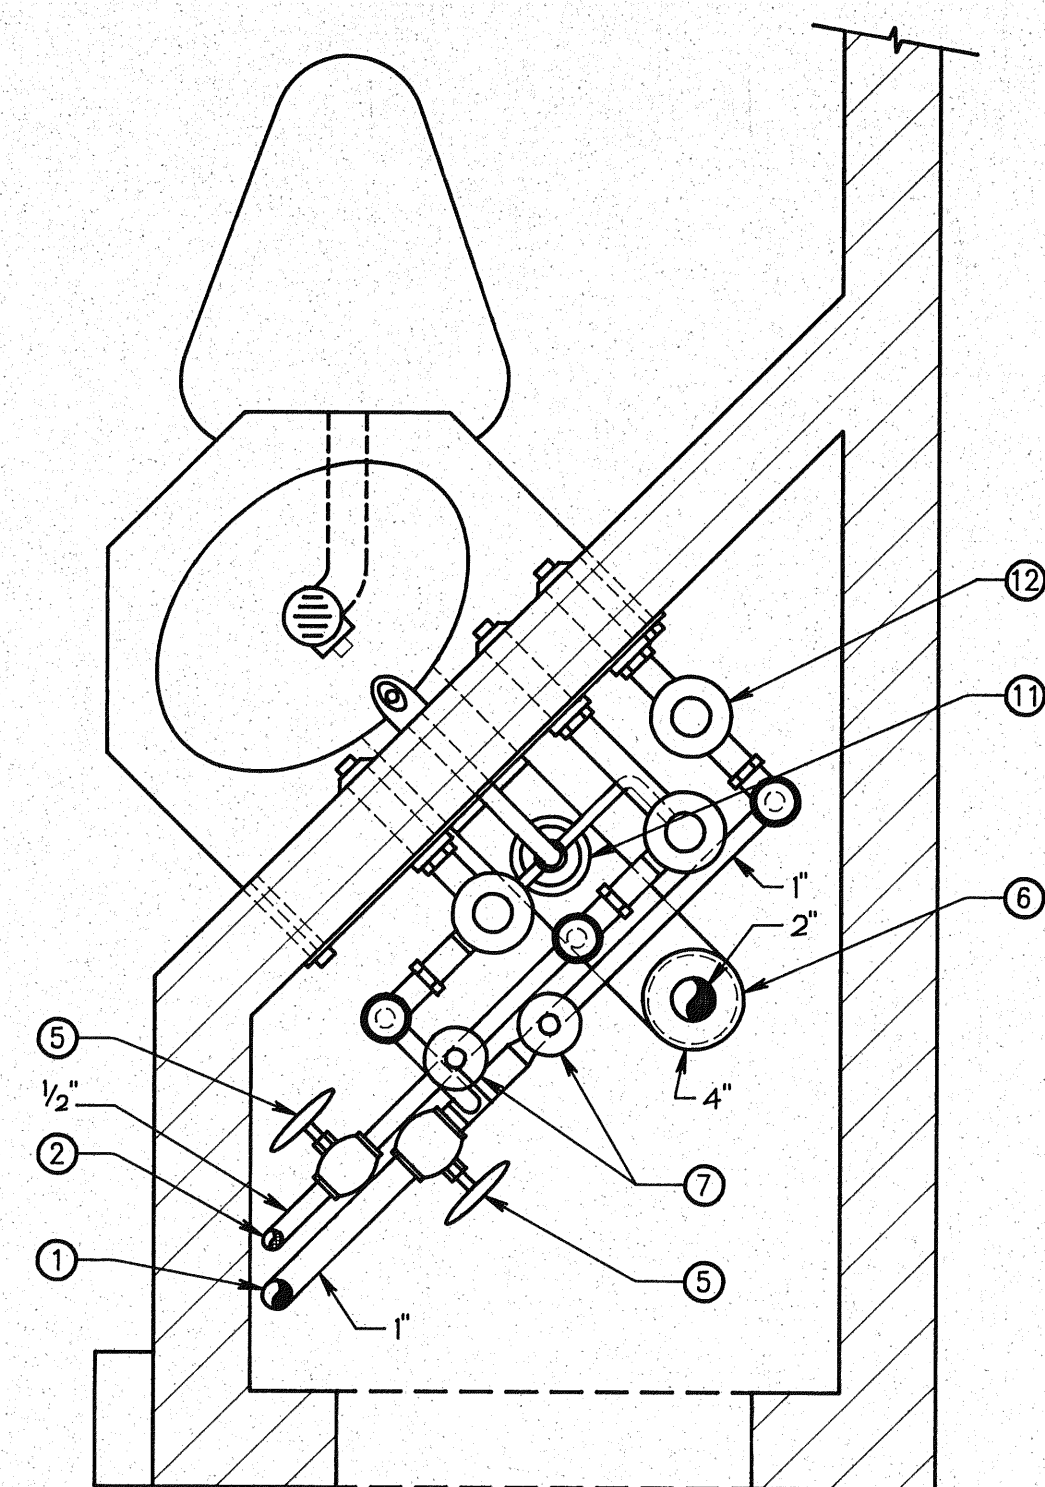


CELL CHASE DETAIL

NOT TO SCALE

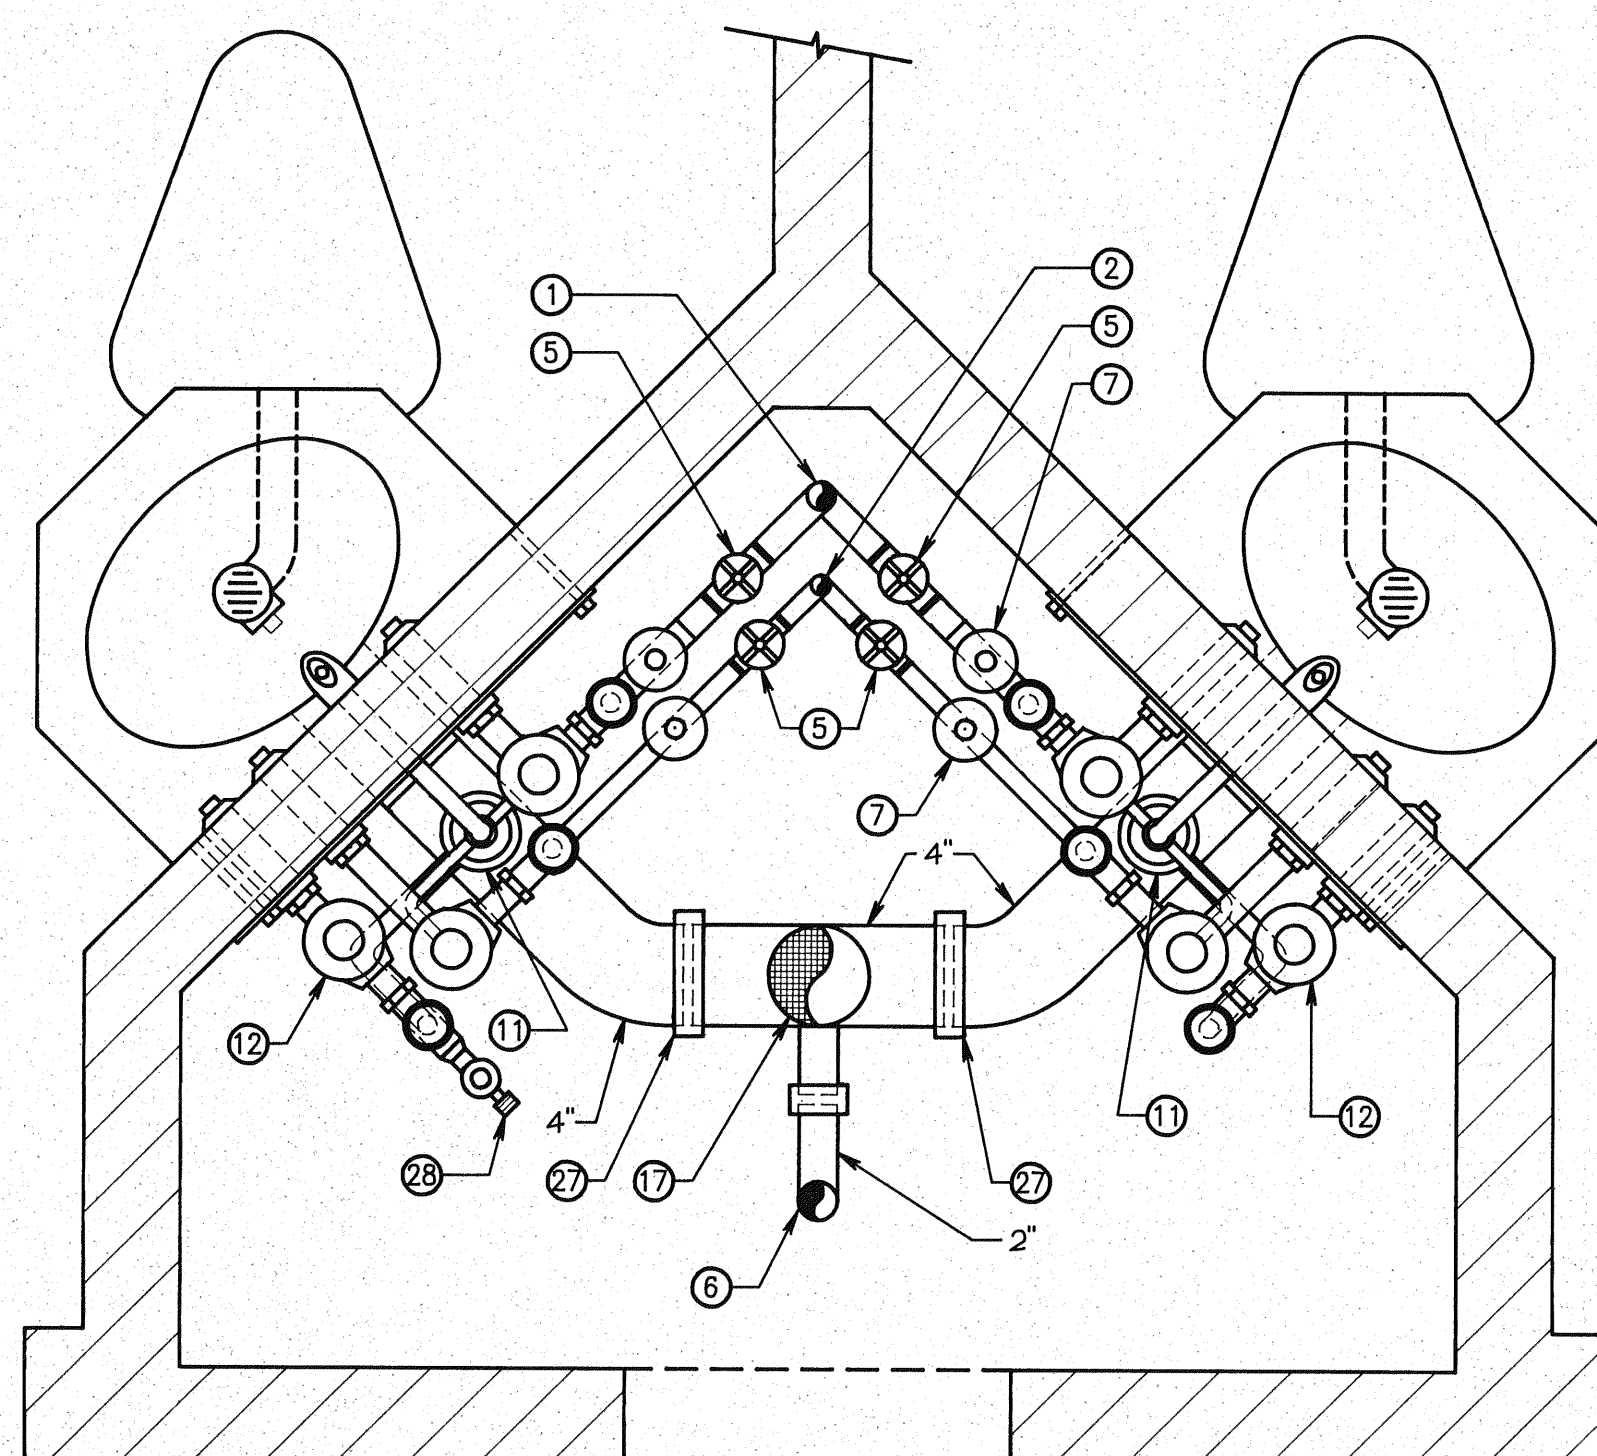


CELL CHASE DETAIL

NOT TO SCALE

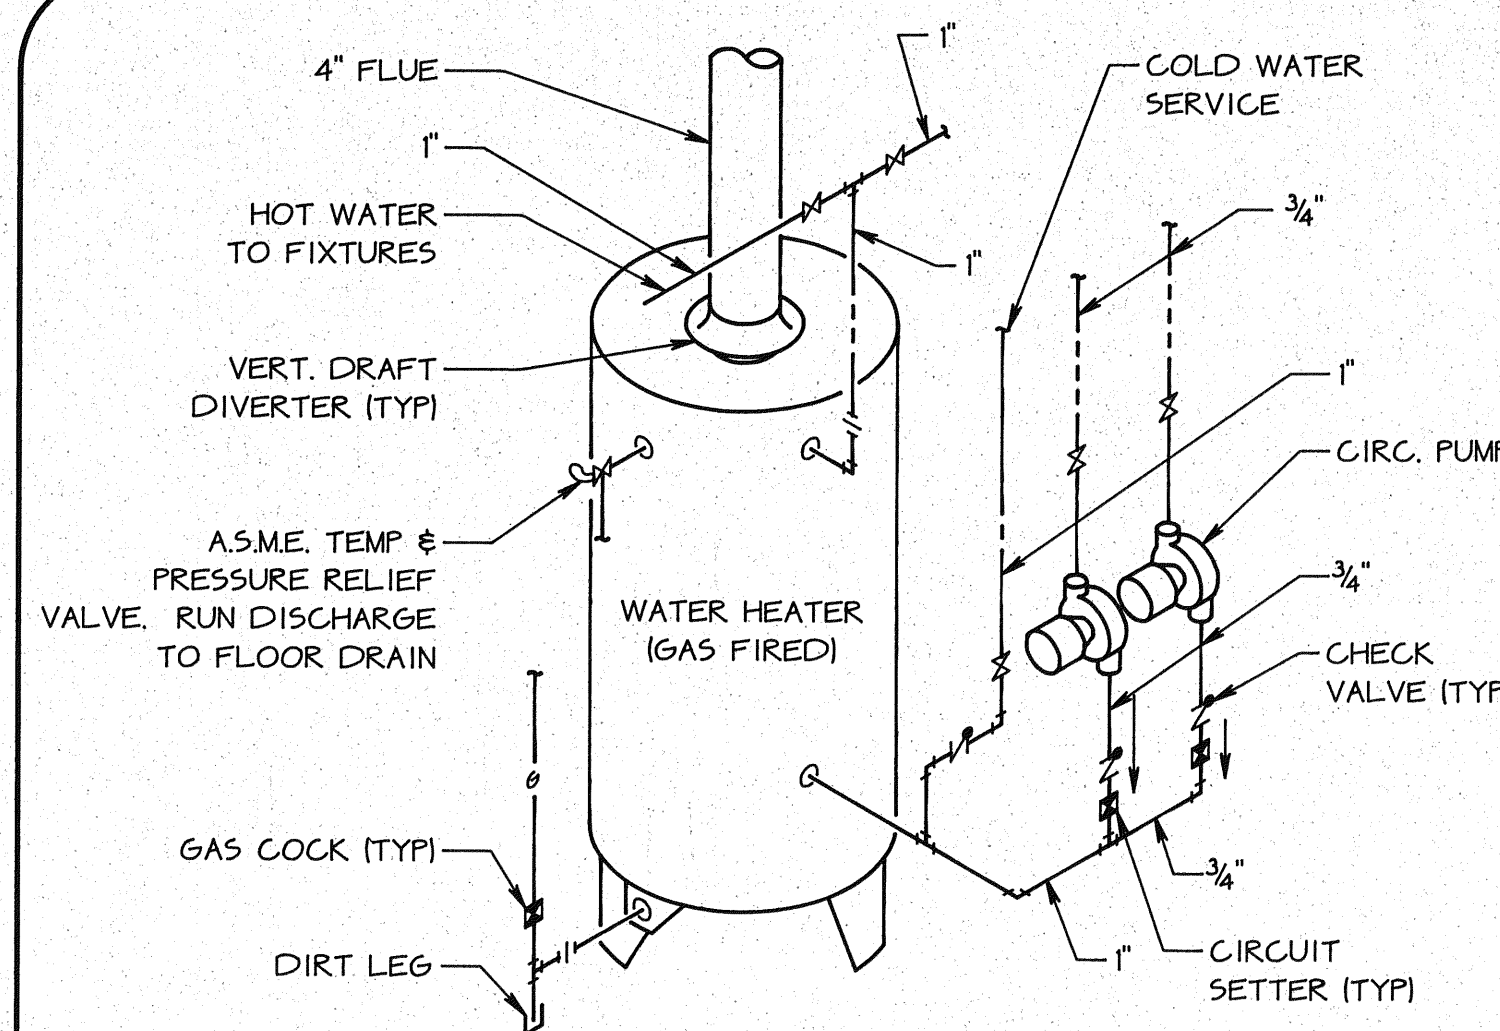


WATER HEATER DETAIL

NOT TO SCALE

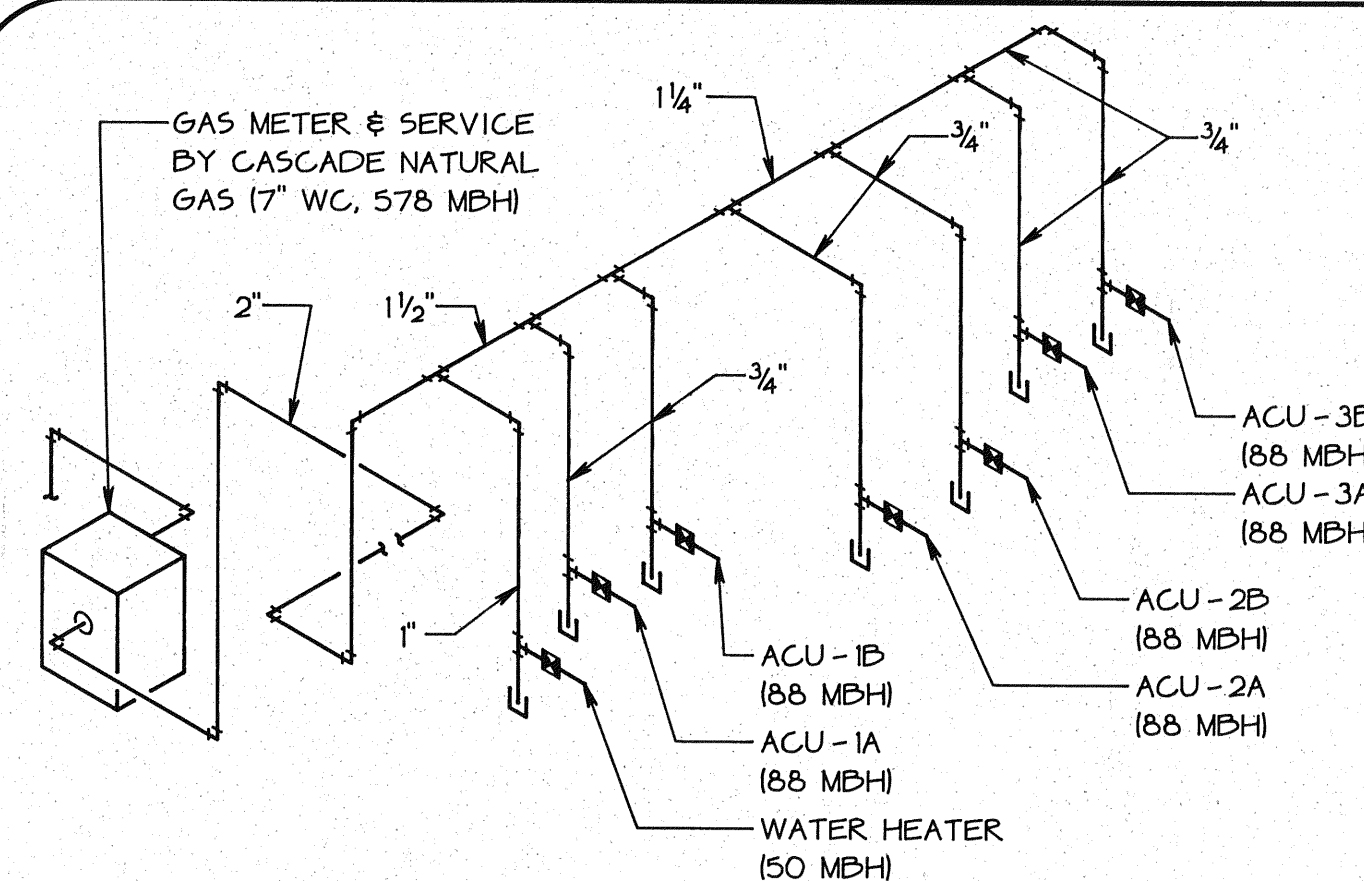

NATURAL GAS RISER DIAGRAM

NOT TO SCALE

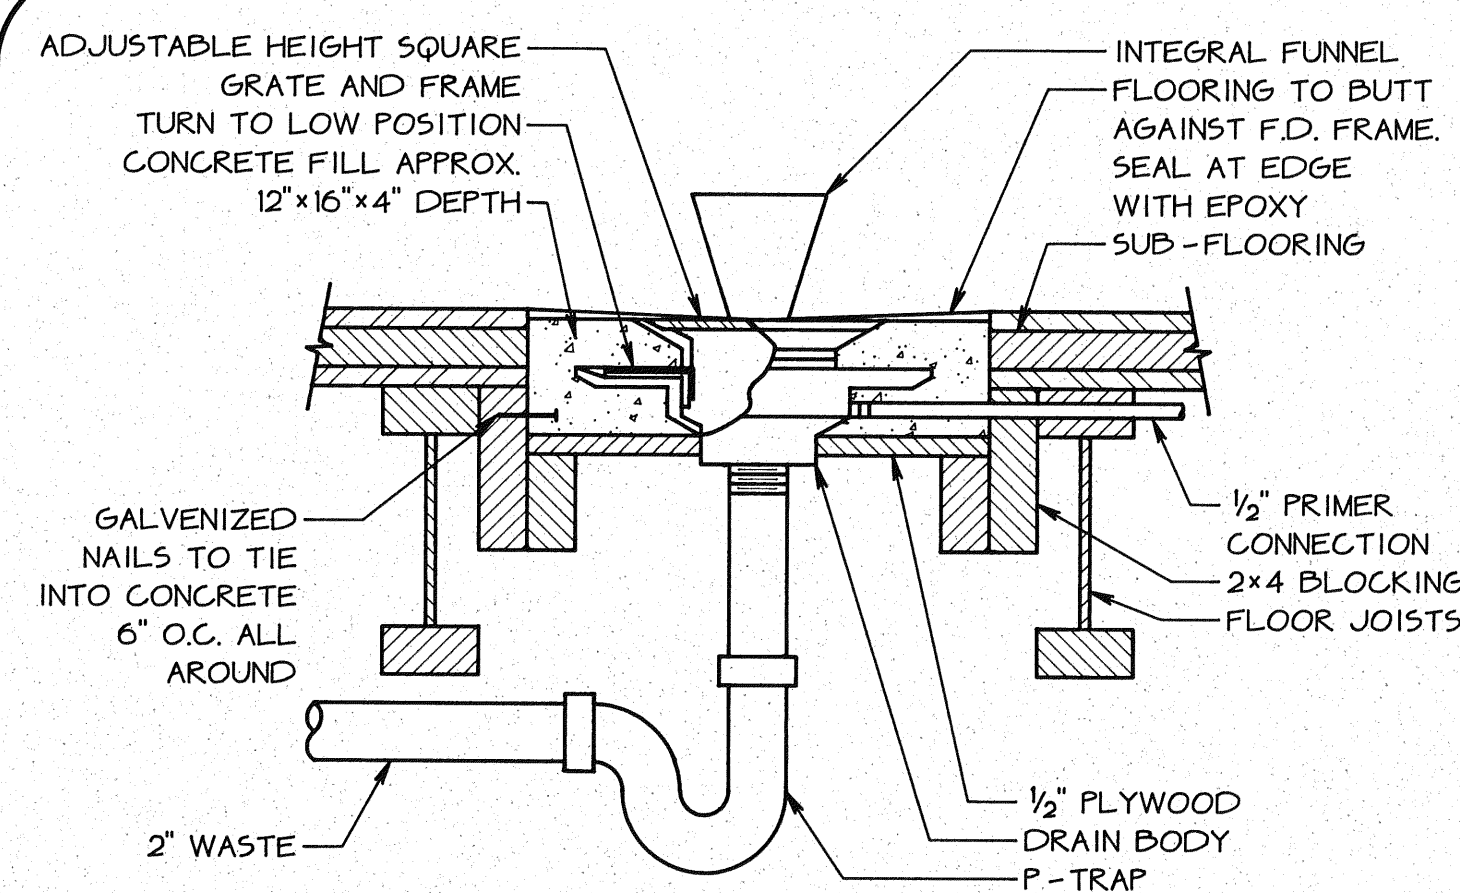

FLOOR DRAIN & WOOD FLOOR DETAIL

NOT TO SCALE

GENERAL NOTES:

1. CHASES WERE DESIGNED USING J.R. SMITH CLOSET SUPPORTS, SLOAN FLUSH VALVES & TYLER PIPE FITTINGS. DIMENSIONAL CRITERIA OF SUPPORTS & VALVES ARE CRITICAL TO SPACE REQUIREMENTS. NOT ALL FITTINGS HAVE BEEN CALLED OUT. EXTREME COORDINATION REQUIRED.

KEY NOTES: (DETAILS 10 & 11)

- ① COLD WATER SUPPLY. SEE DRAWING FOR SIZE.
- ② HOT WATER SUPPLY. SEE DRAWING FOR SIZE.
- ③ 4" WASTE DOWN THRU FLOOR.
- ④ 2½" VENT UP.
- ⑤ SHUT-OFF VALVE.
- ⑥ VENT UP FROM FIXTURE WASTE.
- ⑦ WATER HAMMER ARRESTOR.
- ⑧ J R SMITH FIG. 340 -L-Y CLOSET SUPPORT.
- ⑨ J R SMITH FIG. M-40 EXTENSION SUPPORT..
- ⑩ J R SMITH FIG. M-51 ANCHOR FOOT.
- ⑪ ACORN 1780 -NH ADAPTER W/C.O.
- ⑫ SLOAN 683 FLUSH VALVE ASSEMBLY.
- ⑬ 2" VENT UP FROM BELOW FLOOR.
- ⑭ ½" HOT & COLD WATER HOSE BIBBS ACCESSIBLE FROM ACCESS PANEL.
- ⑮ FLOOR DRAIN TO CELL CHASE.
- ⑯ SLOAN 683 FLUSH VALVE ASSEMBLY (MODIFIED).
- ⑰ 4" WASTE FROM ABOVE.
- ⑱ MIXING VALVE SET AT 105" OUT.
- ⑲ INTEGRAL SLOAN FLUSH VALVE.
- ⑳ SLOAN 150 FLUSH VALVE.
- ㉑ SLOAN EL 172-A PUSH BUTTON AT +48" ABOVE FLOOR.
- ㉒ 2" VENT UP THRU FLOOR & VTR.
- ㉓ SLOAN 110 -FYV FLUSH VALVE.
- ㉔ J R SMITH FIG. 439 -DY BACK TO BACK CLOSET SUPPORT LESS (1) SUPPORT BRACKET.
- ㉕ CAP STACK INLET.
- ㉖ J R SMITH FIG. 447 -Y CLOSET SUPPORT.
- ㉗ WADE W-300 -BWV-M8.
- ㉘ ¾" HOSE BIBB WITH VACUUM BREAKER.



Architects & Engineers

INTEGRUS
ARCHITECTURE

244 West Main Avenue
Spokane, Washington 99201
509/838-8681
FAX 509/838-2194

Mechanical/Electrical Engineers

MW Consulting Engineers
Great Northwest Bldg., Suite 200
222 North Wall Street
Spokane, Washington 99201-0877
509/838-9020
FAX 509/838-1123

Job Number: 9119.50

Drawn By CI

Checked By ROR

Date 9-18-91

Revisions

Sheet Contents

DETAILS